RPZ

INSTALLED WITHIN A FACILITY

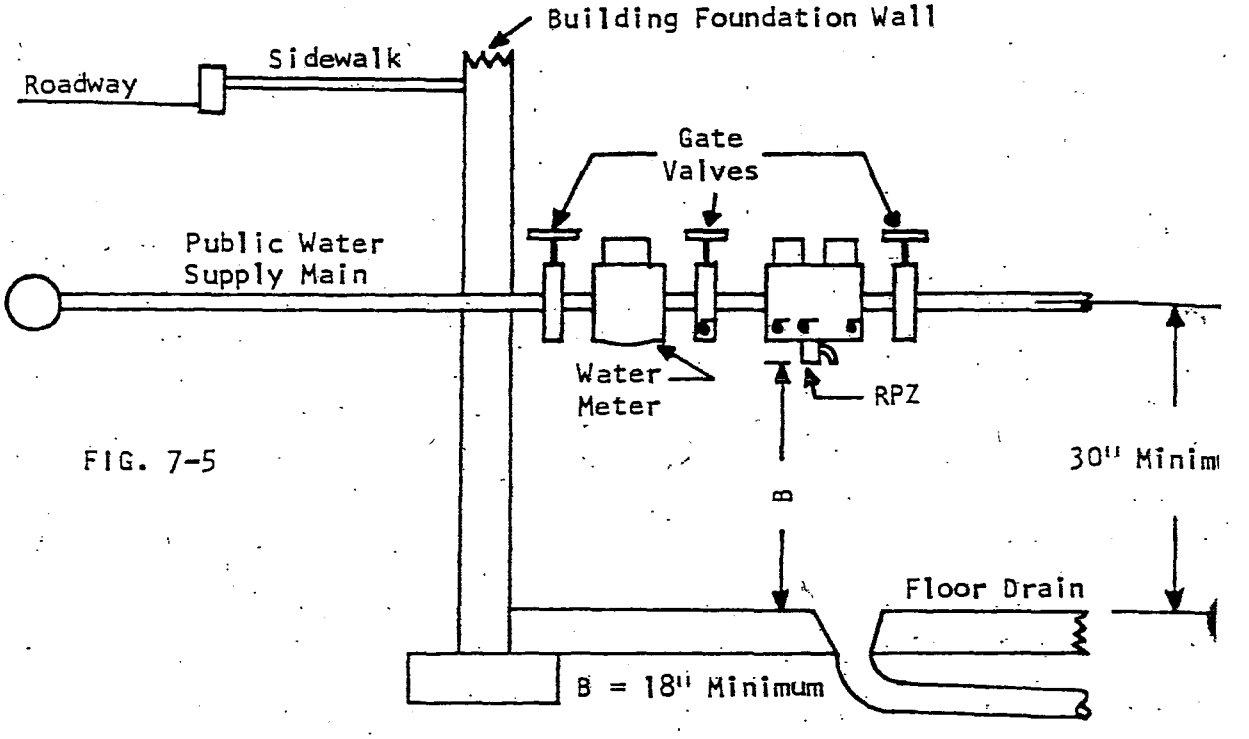

FIG. 7-5
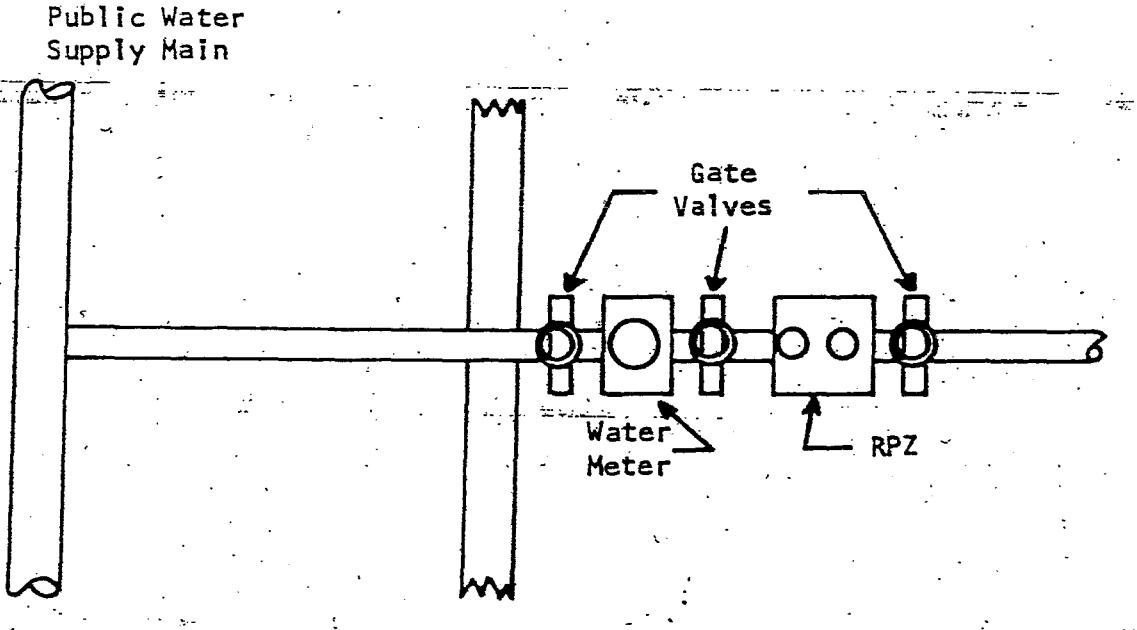
NOTE: Device to be installed above highest possible flooding